

Approved:
CEO: /Ch. Marinov/
Date: 22.06.23

Outgoing Ref. No. 15.01.2025
(filled in by CARBONSAFE)

Monitoring report from on-the-spot inspection

Data of the operator: CSBG-42SC-23/28-AGRI-0013-GF

Natural person	☐	Legal entity	☒
DATA OF THE NATURAL PERSON (filled in by Natural persons only)			
Name:			
Personal ID No.:			
Telephone:			
e-mail:			
DATA OF THE LEGAL ENTITY (filled in by Legal entities only)			
Name:		KURTEV GRUP OOD	
UIC/BULSTAT:		160124968	
Name:		ET BG 21 - YORDAN KURTEV	
UIC/BULSTAT:		115772651	
Telephone:		+359888960909	
e-mail:		scorpion21@abv.bg	

No. in row	Scope of monitoring	Report
1	Grounds for conducting <i>(According to the annual plan, etc.)</i>	Contract No. CSBG-42SC-23/28-AGRI-0013-GF for the implementation of a project under the CARBONSAFE carbon program
2	Inspector <i>(Name, surname)</i>	Hristo Nikolov
3	Purpose of the monitoring <i>(Inspection of the strategy performance)</i>	Establishing the real condition of the areas participating in the program.
4	Method of conducting <i>(Direct observations, interviews with responsible officials, inspection of available/submitted records on the workplaces, by a representative sample)</i>	On-site visits, interview conducted with the farmer.
5	Results/findings <i>(description of the actual situation)</i>	The farm implements the agricultural practices set out in the individual strategy.
6	Submitted documents/records and other findings <i>(descriptions of provided materials)</i>	IN-25.01.14-PR0104-Techn.card_v1_22.06.23_KURTEV GRUP_23-24

7	Established deviations and proposed corrective actions (<i>description of the actual situation</i>)	No deviations were identified during the on-site visit.
8	General evaluation, conclusions and recommendations.	The agricultural practices set out in the individual strategy are implemented on the areas participating in the program. The farm has the opportunity to supplement the practices. It is recommended to work towards ensuring year-round soil cover on the areas participating in the program with annual crops (intermediate and/or cover crops). The use of organic fertilizers, soil improvers and biostimulants is recommended to improve soil health and fertility.

INSTRUCTIONS:

- **Recommended soil treatments:** Vertical treatments for mixing plant residues every 2-3 years, depending on weather conditions.
- **Prohibited soil treatments:** Plowing and overturning of soil layers.

GUIDELINES:


- **Summer period from June 1 to October 31:** Areas must have minimal soil cover, and plowing and overturning of soil layers are not allowed.
- **Winter period from November 1 to February 15:** Areas must have minimal soil cover, and plowing and overturning of soil layers are not allowed.

OBLIGATIONS:


- Every activity, including soil treatments, must be recorded with the corresponding execution dates in the technological map.

Attached photographic material:


Screenshots from registration in the specialized software ISAC02

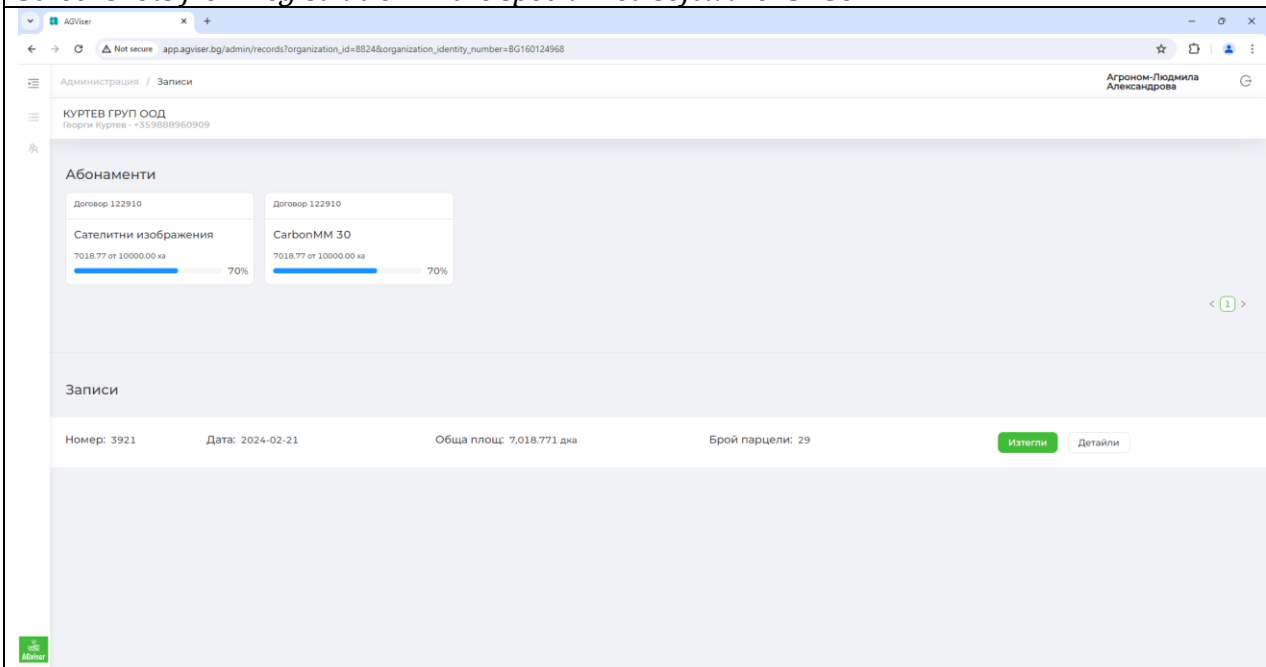

Screenshots from the specialized software ISAC02 – areas 2023/2024

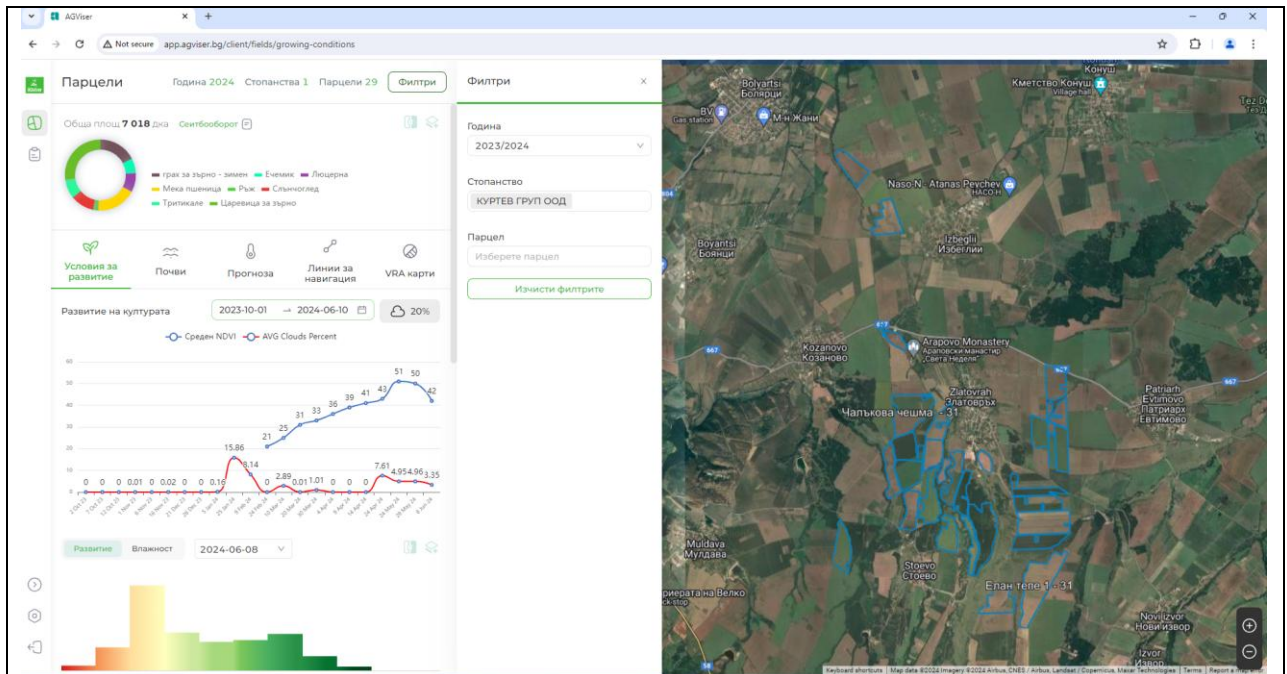

Screenshots from the specialized software ISAC02 – areas 2024/2025

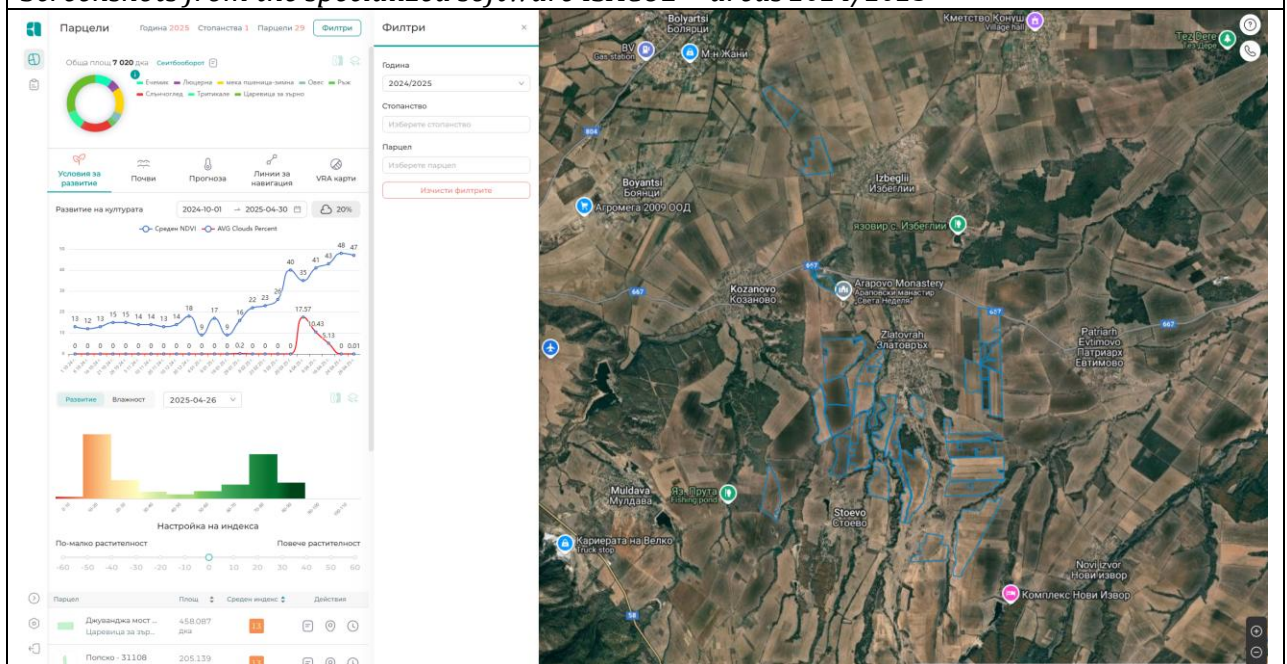

Screenshots from the specialized software ISAC02 – sampling trace excerpt 2023/2024

← Кабата 2 - 31108


Анализи на почвени проби за рН и макроелементи

Тип пробоземане: Изберете тип на пробоземането

Номер на клетка	Лабораторен номер	Парцел	Дълбочина, см	Дата	Почвена реакция рН	Минерален азот TМN мг/кг	Фосфор P ₂ O ₅ мг/кг	Калий K ₂ O мг/кг	Обменен калий СаО мг/кг	Обменен MgO
1	юв-66-34	Кабата 2 - 31108	0-30	2024-03-25	7.64 СЛА	1,349.45 MB	99.63 Д	560.71 MB	4,023.20 B	539.0
1	юв-66-35	Кабата 2 - 31108	30-60	2024-03-25	7.73 СЛА	-	-	-	-	-
1	юв-66-36	Кабата 2 - 31108	60-90	2024-03-25	7.91 УМА	-	-	-	-	-

Кратки коментари въз основа на получените резултати

- Дълбочина, см: 0-30 Преобладаващата почвена реакция е слабо алкална
- Дълбочина, см: 30-60 Преобладаващата почвена реакция е слабо алкална
- Дълбочина, см: 60-90 Преобладаващата почвена реакция е умерено алкална
- Дълбочина, см: 0-30 Преобладаващият запас на усвоим фосфор е добър
- Дълбочина, см: 0-30 Преобладаващият запас на обменен калий е много висок

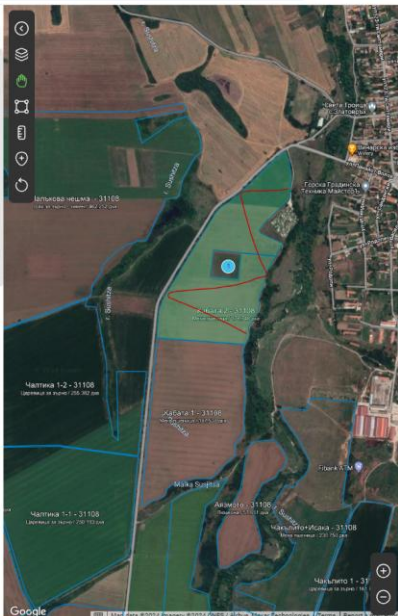

Screenshots from the specialized software ISAC02 – sampling trace excerpt 2024/2025

← Кабата 2 - 31108

Анализи на почвени проби за рН и макроелементи

Тип пробоземане: Изберете тип на пробоземането


Номер на клетка	Лабораторен номер	Парцел	Дълбочина, см	Дата	Почвена реакция рН	Минерален азот TМN мг/кг	Фосфор P ₂ O ₅ мг/кг	Калий K ₂ O мг/кг	Обменен калий СаО мг/кг
1	юв-132-1	Кабата 2 - 31108	0-30	2025-02-27	7.50 СЛА	756.35 MB	108.95 Д	584.07 MB	15,636.33 B
1	юв-132-2	Кабата 2 - 31108	30-60	2025-02-27	7.84 УМА	-	-	-	-
1	юв-132-3	Кабата 2 - 31108	60-90	2025-02-27	8.00 УМА	-	-	-	-

Кратки коментари въз основа на получените резултати


- Дълбочина, см: 0-30 Преобладаващата почвена реакция е слабо алкална
- Дълбочина, см: 30-60 Преобладаващата почвена реакция е умерено алкална
- Дълбочина, см: 60-90 Преобладаващата почвена реакция е умерено алкална
- Дълбочина, см: 0-30 Преобладаващият запас на усвоим фосфор е добър
- Дълбочина, см: 0-30 Преобладаващият запас на обменен калий е много висок
- Дълбочина, см: 0-30 Преобладаващият запас на обменен калий е висок
- Дълбочина, см: 0-30 Преобладаващият запас на обменен магнезий е висок
- Дълбочина, см: 0-30 Съдържанието на сярна е високо




Screenshots from the specialized software ISAC02 – sampling trace excerpt 2023/2024

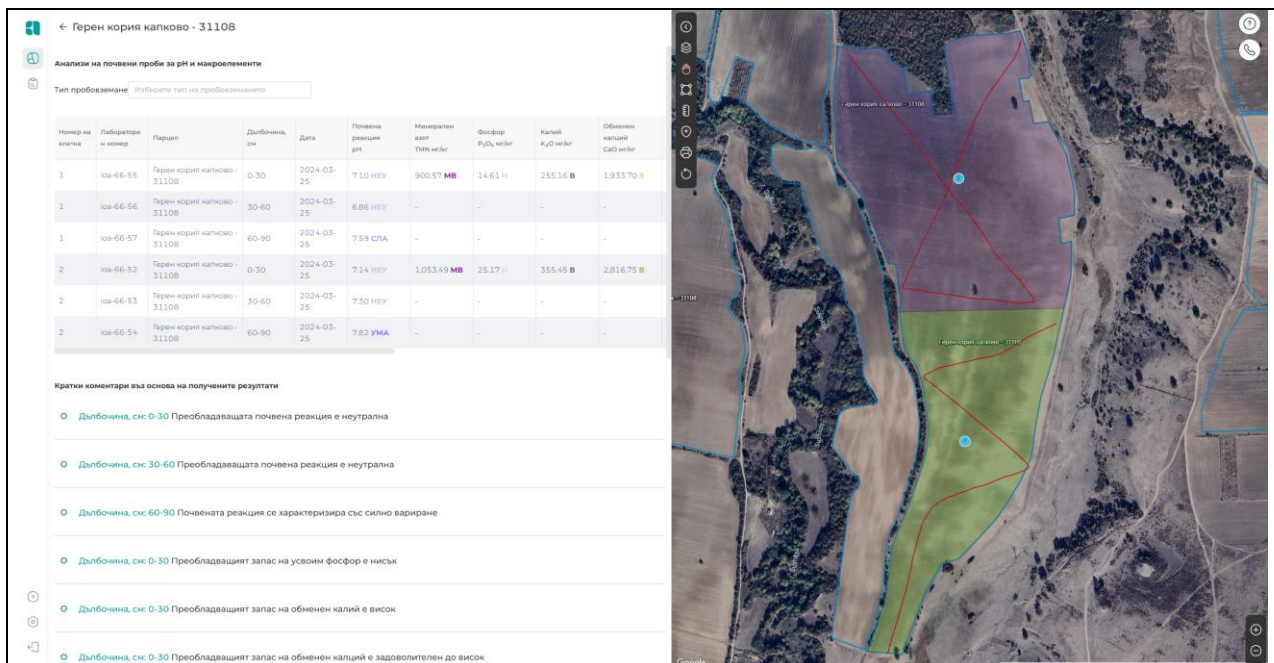

Screenshots from the specialized software ISAC02 – sampling trace excerpt 2024/2025

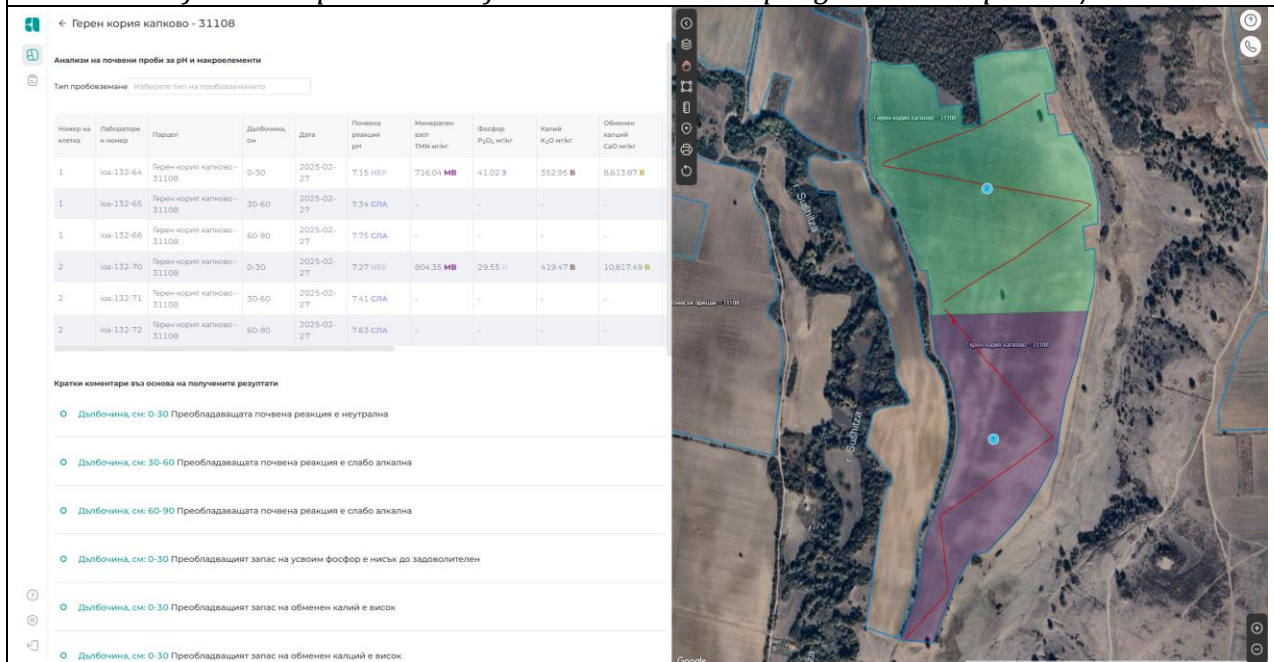

Screenshots from the specialized software ISAC02 – loaded results from laboratory tests 2023/2024

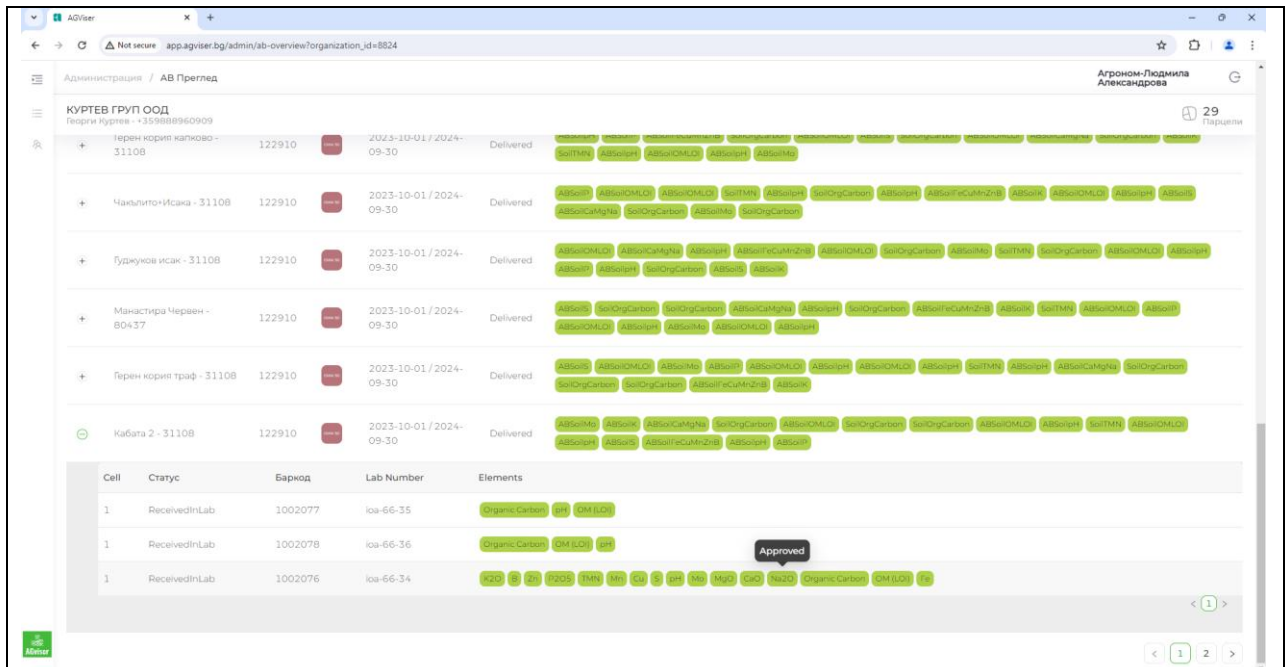

Cell	Статус	Баркод	Lab Number	Elements
1	ReceivedInLab	1002077	ioa-66-35	Organic Carbon, OM (LOI), pH
1	ReceivedInLab	1002078	ioa-66-36	Organic Carbon, OM (LOI), pH
1	ReceivedInLab	1002076	ioa-66-34	C, N, P, K, Ca, Mg, S, Zn, Cu, Fe, Mn, Na, Si, Al, Ti, B, Mo, Ni, Co, Se, V, Cr, Pb, Cd, Hg, As, Sb, Sn, Bi, Te, U, Th, Pa, La, Ce, Pr, Nd, Sm, Eu, Gd, Tb, Dy, Ho, Er, Tm, Yb, Lu, Be, Sc, Y, Zr, Nb, Mo, Tc, Ru, Rh, Pd, Ag, Au, Hg, Tl, Pb, Bi, Po, At, Rn, Fr, Ra, Ac, Th, Pa, U, Np, Pu, Am, Cm, Bk, Cf, Es, Fm, Md, No, Lr, La, Ce, Pr, Nd, Sm, Eu, Gd, Tb, Dy, Ho, Er, Tm, Yb, Lu, Be, Sc, Y, Zr, Nb, Mo, Tc, Ru, Rh, Pd, Ag, Au, Hg, Tl, Pb, Bi, Po, At, Rn, Fr, Ra, Ac, Th, Pa, U, Np, Pu, Am, Cm, Bk, Cf, Es, Fm, Md, No, Lr

Screenshots from the specialized software ISAC02 – loaded results from laboratory tests 2024/2025



Cell	Статус	Баркод	Lab Number	Elements
1	ReceivedInLab	1005363	ioa-132-2	Organic Carbon, OM (LOI), pH
1	ReceivedInLab	1005364	ioa-132-3	Organic Carbon, OM (LOI), pH
1	ReceivedInLab	1005362	ioa-132-1	C, N, P, K, Ca, Mg, S, Zn, Cu, Fe, Mn, Na, Si, Al, Ti, B, Mo, Ni, Co, Se, V, Cr, Pb, Cd, Hg, As, Sb, Sn, Bi, Te, U, Th, Pa, La, Ce, Pr, Nd, Sm, Eu, Gd, Tb, Dy, Ho, Er, Tm, Yb, Lu, Be, Sc, Y, Zr, Nb, Mo, Tc, Ru, Rh, Pd, Ag, Au, Hg, Tl, Pb, Bi, Po, At, Rn, Fr, Ra, Ac, Th, Pa, U, Np, Pu, Am, Cm, Bk, Cf, Es, Fm, Md, No, Lr

Screenshots from the specialized software ISAC02 – loaded results from laboratory tests 2023/2024

Администрация / АВ Преглед

Агроном-Тяна Асенова

КУРТЕВ ГРУП ООД

Всички куртеви - 030808000000

29

Параметри

+	Древна дъска Тосков - 31108	122910	Доставена	2023-10-01 / 2024-09-30	Доставена	ABSObs, ABSOCHL, ABSOCHML, ABSOCH, SO1TH, SO1OGen, SO1OGen, ABSO
---	-----------------------------	--------	-----------	-------------------------	-----------	--

Screenshots from the specialized software ISAC02 – loaded results from laboratory tests 2024/2025

2024-10-01

Администрация / АВ Преглед

Агроном-Тяна Асенова

КУРТЕВ ГРУП ООД

Всички куртеви - 030808000008

29

Резултати

+	Древна дъска Тосков - 31108	122910		2024-10-01 / 2025-09-30	Доставена	Organic Carbon, OM, LOD, N2O, CO2, N
---	-----------------------------	--------	-------------	-------------------------	-----------	--

Photographic material from the on-site visit

Аязмото - 31108	Гуджуков исак - 31108	Зад коруите 1 - 31108
-----------------	-----------------------	-----------------------



Date 15.01.2025

Agronomist:
(Tanya Asenova, TA1124CS)